

AMENDMENT 4

**INVITATION FOR BID
UOG IFB No. B25-03**


Date Issued: January 23, 2025

“PURCHASE & INSTALLATION OF CNAS GENERATORS & ATS CABINETS”

This is to notify all prospective offerors of the following amendment set forth below:

1.1 QUESTION & ANSWER SHEET 3 set forth as attached.

All other terms and conditions remain the same.

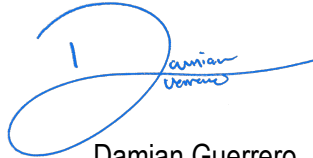

Damian Guerrero
Interim Procurement Manager

Please acknowledge receipt and return by email to uog.bids@triton.uog.edu:

Name of company: _____

Print Name/Signature/Date

QUESTION & ANSWER SHEET NO.3

January 23, 2025

*In response to the written "Questions" and/or 'Request for Clarifications' UOG received as of January 22, 2025
@ 11:03 pm from vendor: **GENSET POWER***

Question 1: The BID specifies Fuel Tank Capacity 260 Gallons. Please clarify if this is a sub-base tank and whether or not the new unit will be connected to the existing fuel lines.

If the new unit is going to be connected to existing fuel lines, then a sub-base tank is not required. Furthermore, the "open" type generator is stationary (similar to the existing unit, refer to attachment #02). The BID is calling for a Mobile Generator, trailer mounted. Please clarify.

Answer: UOG: Originally per our Federal funding source, equipment is not allowed to be fixed to a building/structure. We were able to use a different funding source for the ALS building so it does not need to be mobile and can be connected to existing fuel lines. A trailer and sub fuel tank are not needed.